


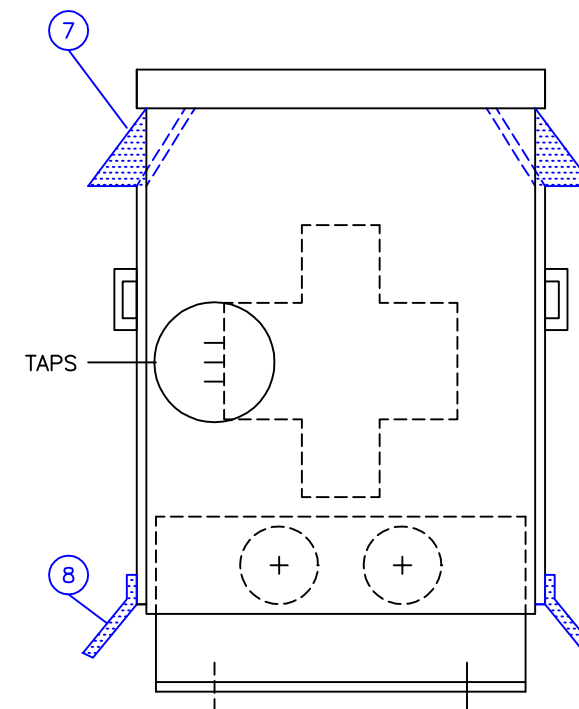

TRANSFORMER'S PROPERTIES						
KVA RATING	TEMP RISE	APPRX WT (LBS)		TAPS @ PRI. VOLTS		
		ALUM	COPPER	480	240	208
300	—	—	—	—	—	—
	—	—	—	—	—	—
	80°C	1900	2180	2A4B 2.5%	1A2B 5%	1A2B 5%
500	150°C	2430	2660	2A4B 2.5%	1A2B 5%	1A2B 5%
	115°C	2580	2900	2A4B 2.5%	1A2B 5%	1A2B 5%
	—	—	—	—	—	—
	—	—	—	—	—	—

S.O. NO: — — —	DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE	
CUST/JOB NAME: CUST ORDER NO: SERIAL NO: ID TAG:		
KVA: HIGH VOLTAGE: LOW VOLTAGE: HV TAPS: SEE TABLE HV-KV BIL: 10 LV-KV BIL: 10 PHASE: 3 FREQ-HZ: 60 TEMP RISE-°C: COOLING CLASS: AA COOLING FLUID: WINDING COND: PAINT/COATING: ANSI 61 GRAY APPRX WT-LBS: SEE TABLE		
HV COORD: — LV COORD: —		

1) THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES. VERIFY WITH FACTORY BEFORE CONSTRUCTION.

2) K FACTOR MIGHT CHANGE CASE DIMENSIONS, CHECK WITH FACTORY BEFORE CONSTRUCTION.

3) TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.

4) UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH $\pm 1/4"$ TOLERANCE.

5) TRANSFORMER IS U.L. LISTED.

6) WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.

		PAGE 1 OF 1	SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE- OUTDOOR 600V DRY TYPE 'E' GENERAL PURPOSE		
		BY	DATE			
		CADD: ME	9/18/03			
		CHKD:				
REVISIONS		APPD:				



MGM
TRANSFORMERS
BY FORGENT

3430 E. 26TH STREET, VERMON, CA 95066 • TEL (213)726-0888 • FAX (213)726-8224

CAD NO.

___ _ _

REV.

___ _ _