

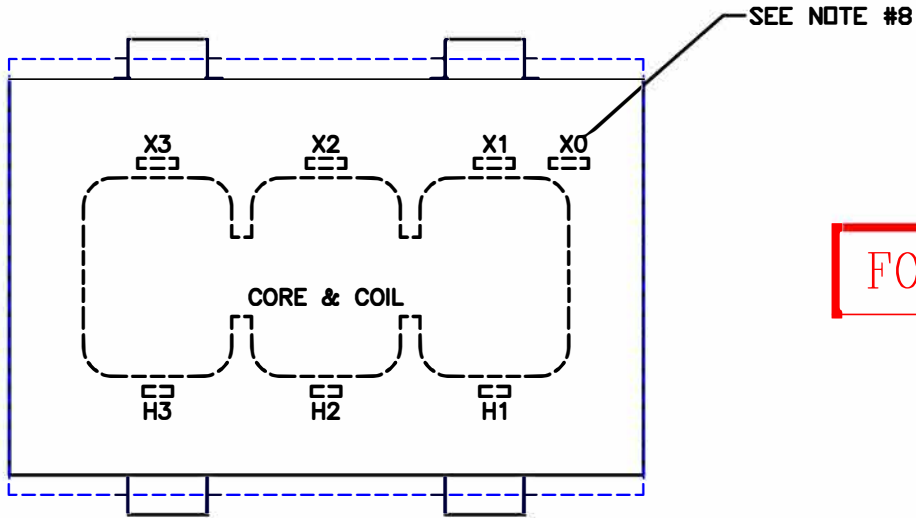
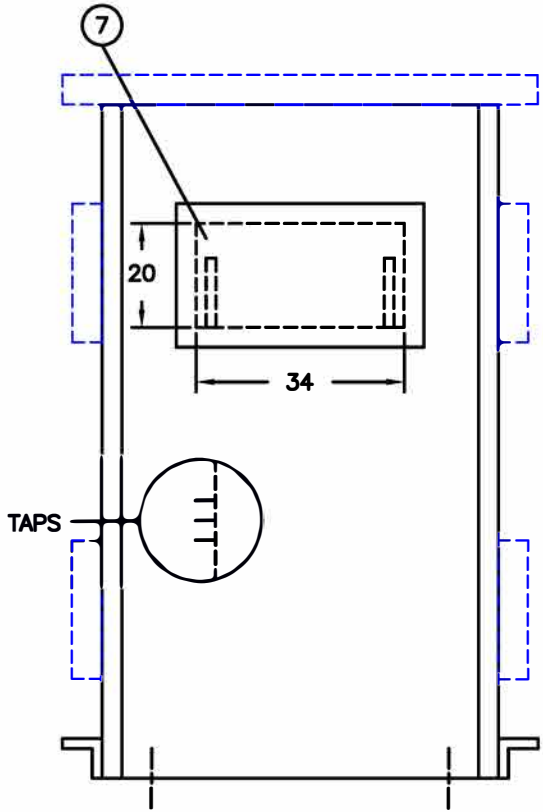


°C RISE	KVA	KV CLASS	KV BIL
150°C	300	15	60, 95

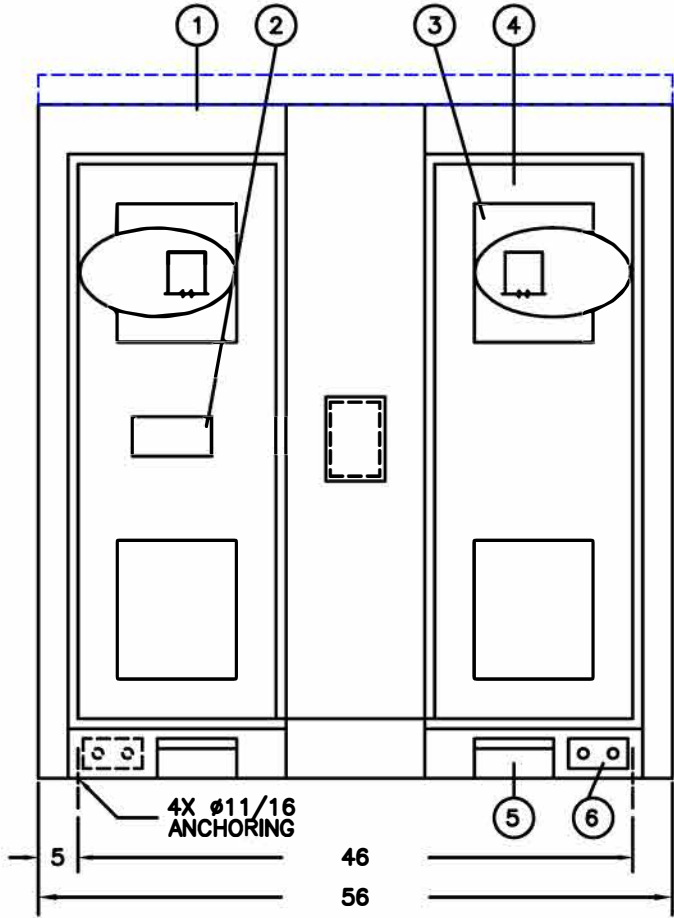

FOR REFERENCE ONLY

LEGEND		
ITEM	QTY	DESCRIPTIONS
1	2	REMOVABLE TOP COVER – FLUSH FOR INDOOR, * CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	8	VENT – SCREEN FOR INDOOR/ LOUVERS FOR OUTDOOR
4	4	BOLTED PANEL
5	4	JACK PAD
6	2	GROUND PAD – NEMA STANDARD
7	2	CABLE/BUS ENTRY CUTOUT WITH COVER

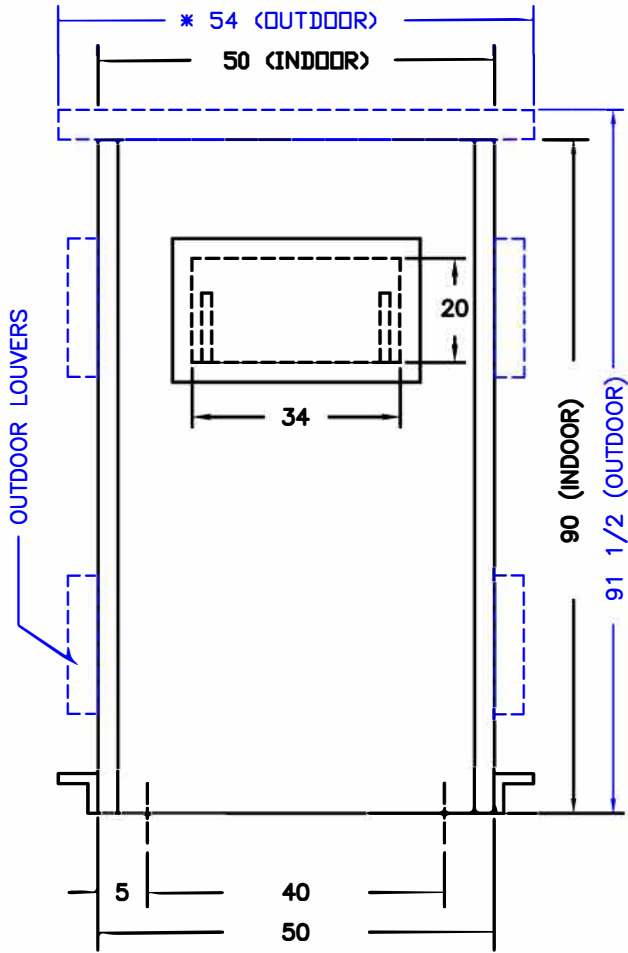

S.O. NO:	
DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE	
CUST/JOB NAME:	
CUST ORDER NO:	
SERIAL NO:	
ID TAG:	
KVA: HIGH VOLTAGE: LOW VOLTAGE: HV TAPS: 2A2B 2 1/2% HV-KV BIL: LV-KV BIL: PHASE: 3 FREQ-HZ: 60 TEMP RISE-°C: INSUL. CLASS: 220°C COOLING CLASS: AA WINDING COND: PAINT/COATING: ANSI 61 GRAY APPRX WT-LBS:	
HV COORD:	☐ INDOOR
LV COORD:	☐ OUTDOOR

- NOTES:**
- 1) THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
 - 2) K FACTOR MIGHT CHANGE CASE DIMENSIONS.
 - 3) TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
 - 4) UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH $\pm 1/4"$ TOLERANCE.
 - 5) TRANSFORMER IS U.L. LISTED.
 - 6) TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESSIBLE LOCATION, OTHERWISE IT MUST BE FENCED OR ISOLATED.
 - 7) WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
 - 8) FOR LV WYE CONNECTION ONLY.

	PAGE 1 OF 1	SCALE: NONE	TITLE:	DRY TRANSFORMER OUTLINE
	BY	DATE		DRY TYPE UNIT SUBSTATION
	CADD: LGL	8/20/99		
	CHK :	9/18/03		
REVISIONS	APPD:			



DRW NO. 905650U
REV.