

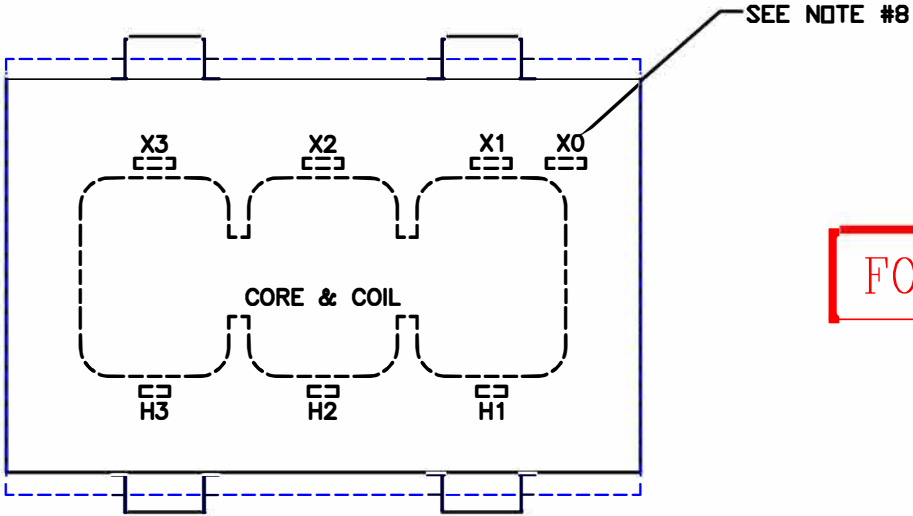
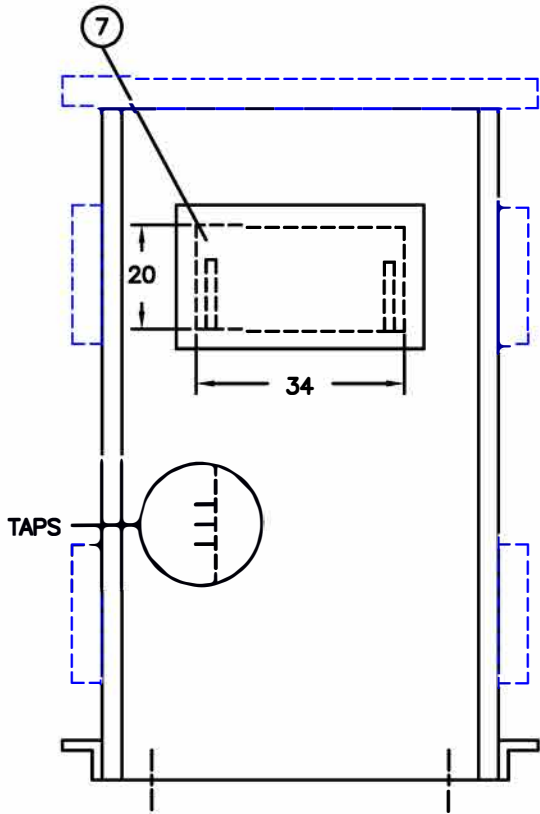


°C RISE	KVA	KV CLASS	KV BIL
150°C	225	25	110
	500	15	60, 95

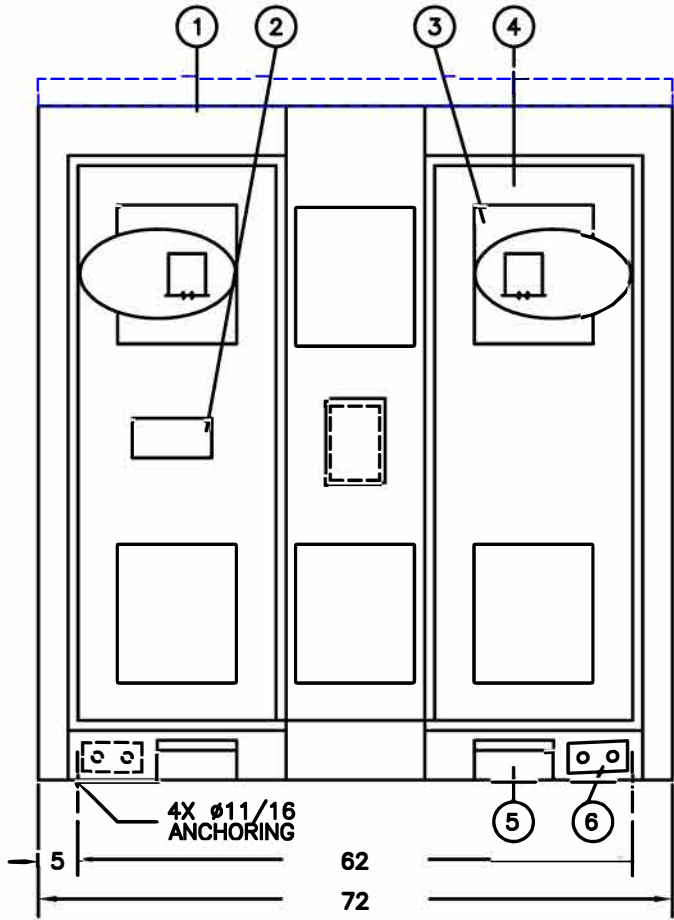

FOR REFERENCE ONLY

LEGEND		
ITEM	QTY	DESCRIPTIONS
1	2	REMOVABLE TOP COVER – FLUSH FOR INDOOR, * CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	12	VENT – SCREEN FOR INDOOR/ LOUVERS FOR OUTDOOR
4	4	BOLTED PANEL
5	4	JACK PAD
6	2	GROUND PAD – NEMA STANDARD
7	2	CABLE/BUS ENTRY CUTOUT WITH COVER

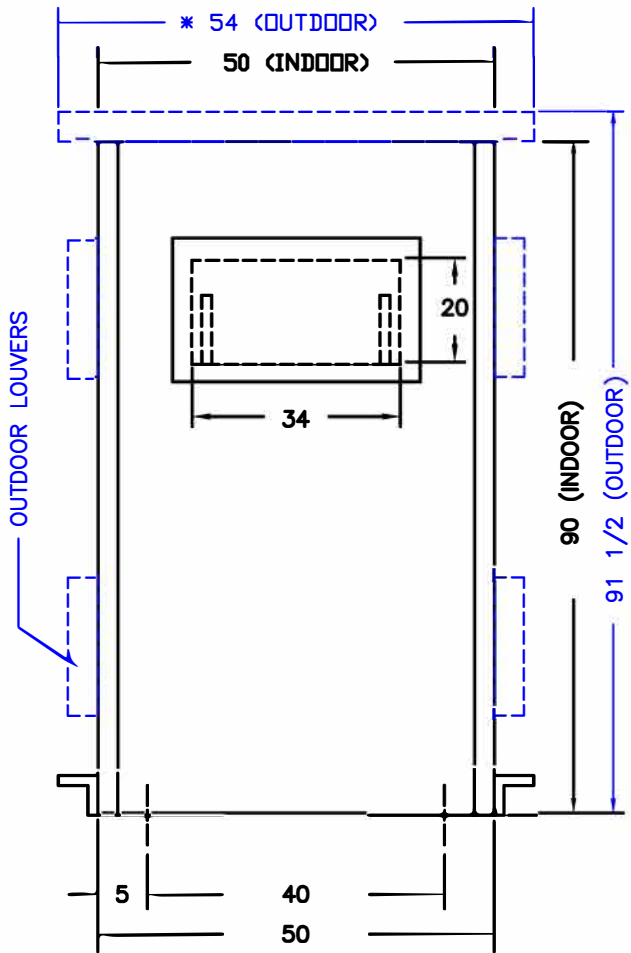

S.O. NO:
DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE

CUST/JOB NAME:
CUST ORDER NO:
SERIAL NO:
ID TAG:

KVA:
HIGH VOLTAGE:
LOW VOLTAGE:
HV TAPS: 2A2B 2 1/2%
HV-KV BIL:
LV-KV BIL:
PHASE: 3
FREQ-HZ: 60
TEMP RISE-°C:
INSUL. CLASS: 220°C
COOLING CLASS: AA
WINDING COND:
PAINT/COATING: ANSI 61 GRAY
APPRX WT-LBS:

HV COORD: ☐ INDOOR
LV COORD: ☐ OUTDOOR

- NOTES:
- THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
 - K FACTOR MIGHT CHANGE CASE DIMENSIONS.
 - TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
 - UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH $\pm 1/4"$ TOLERANCE.
 - TRANSFORMER IS U.L. LISTED.
 - TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESSIBLE LOCATION, OTHERWISE IT MUST BE FENCED OR ISOLATED.
 - WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
 - FOR LV WYE CONNECTION ONLY.

PAGE 1 OF 1		SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE DRY TYPE UNIT SUBSTATION	
BY		DATE		
CADD: LGL		8/20/99		
CHKD: VHA		9/18/03		
REVISIONS		APPD:		

 **EMPOWERING THE FUTURE**
MGM TRANSFORMERS

DRW NO. 907250U
REV.