

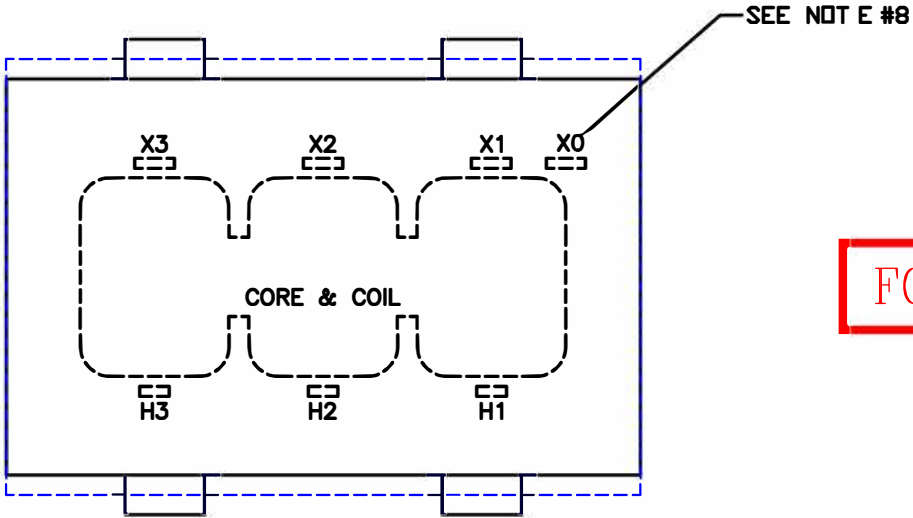
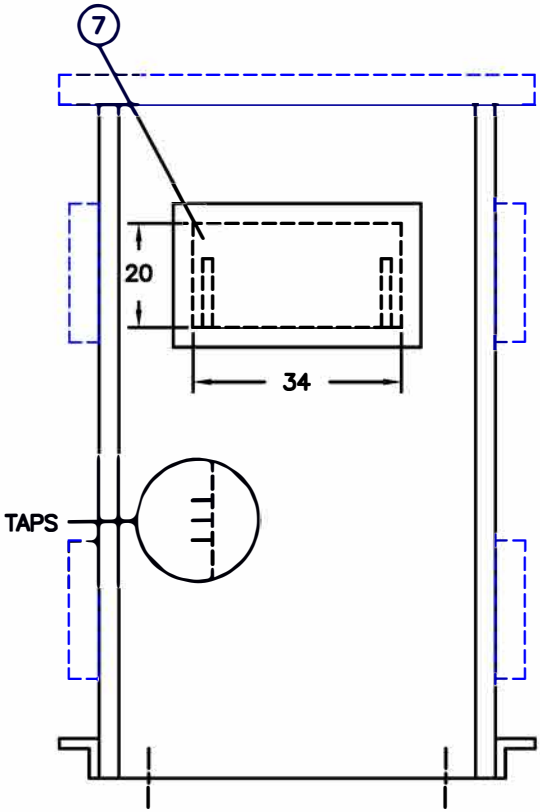


°C RISE	KVA	KV CLASS	KV BIL
150°C	500	25	110
	750	5	30
		15	60, 95
	1000	1.2	10

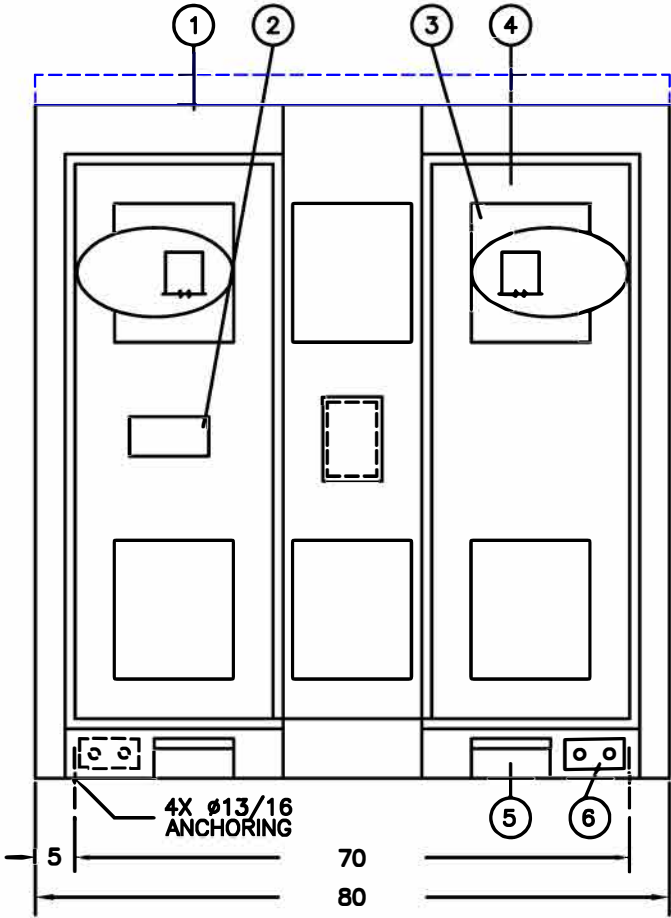

FOR REFERENCE ONLY

LEGEND		
ITEM	QTY	DESCRIPTIONS
1	3	REMOVABLE TOP COVER – FLUSH FOR INDOOR, * CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	12	VENT – SCREEN FOR INDOOR/ LOUVERS FOR OUTDOOR
4	4	BOLTED PANEL
5	4	JACK PAD
6	2	GROUND PAD – NEMA STANDARD
7	2	CABLE/BUS ENTRY CUTOUT WITH COVER

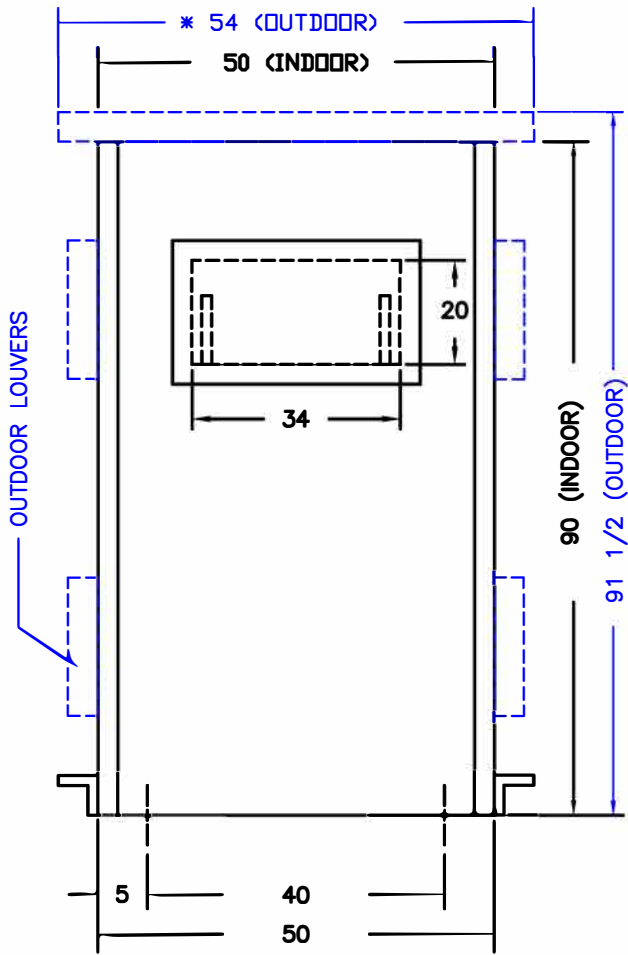

- NOTES:
- THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
 - K FACTOR MIGHT CHANGE CASE DIMENSIONS.
 - TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
 - UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH $\pm 1/4"$ TOLERANCE.
 - TRANSFORMER IS U.L. LISTED.
 - TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESSIBLE LOCATION, OTHERWISE IT MUST BE FENCED OR ISOLATED.
 - WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
 - FOR LV WYE CONNECTION ONLY.

S.O. NO:	
DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE	
CUST/JOB NAME:	
CUST ORDER NO:	
SERIAL NO:	
ID TAG:	
KVA:	
HIGH VOLTAGE:	
LOW VOLTAGE:	
HV TAPS: 2A2B 2 1/2%	
HV-KV BIL:	
LV-KV BIL:	
PHASE: 3	
FREQ-HZ: 60	
TEMP RISE-°C:	
INSUL. CLASS: 220°C	
COOLING CLASS: AA	
WINDING COND:	
PAINT/COATING: ANSI 61 GRAY	
APPRX WT-LBS:	
HV COORD:	☐ INDOOR
LV COORD:	☐ OUTDOOR

PAGE 1 OF 1		SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE	
BY		DATE	DRY TYPE UNIT SUBSTATION	
CADD: LGL		8/20/99		
CH: VHA		9/18/03		
APPD:				
REVISIONS				



DRW NO. 908050U REV.